

EE-527: MicroFabrication

Flammability of Compounds


Flammability Range

- Upper Explosive Limit (UEL)
- Lower Explosive Limit (LEL)
 - volume percent of substance in air that will sustain combustion
- Flammable Range: UEL - LEL, in percent
 - Example: xylene
 - UEL = 7.0% above this concentration, mixture is too rich to burn
 - LEL = 1.1% below this concentration, mixture is too lean to burn

Flammability Points

- Flash Point: minimum temperature where a spark or flame will cause an instantaneous flash in the vapor space above a liquid
- Fire Point: minimum temperature of a liquid to support continuous combustion after ignition via a spark or flame
- Autoignition Point: minimum temperature at which a liquid spontaneously ignites without the introduction of a spark or flame
 - Example: xylene
 - autoignition point (AP) = 496 C
 - boiling point (BP) = 138 C
 - fire point = 44 C [usually about 20 C higher than FP]
 - flash point (FP) = 25 C





Fire Tetrahedron

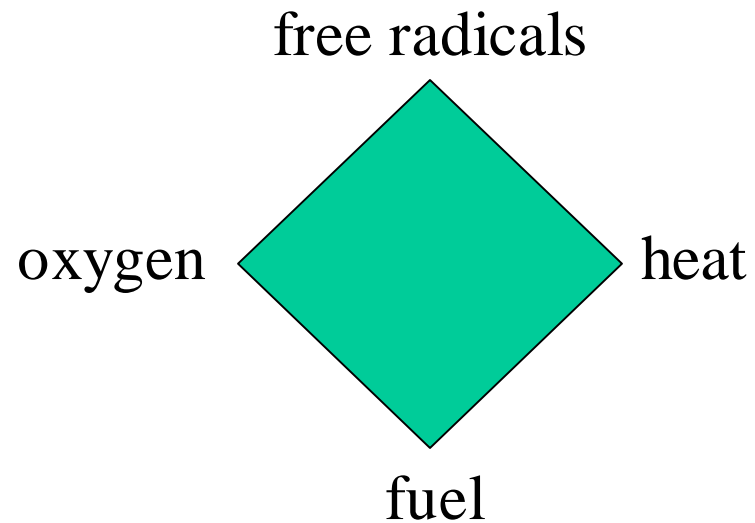

BLEVE: boiling liquid expanding vapor explosion
---gas cylinders with liquefied contents

Fire Classifications

- Class A - common combustibles that leave coals or embers
- Class B - flammable liquids and gases
- Class C - fires in energized electrical equipment
- Class D - combustible metals: Al, Mg, Li, Na, K, Ti, Zr

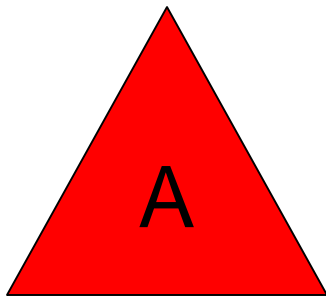

Fire Extinguishants

- Water - Class A fires only
- Carbon Dioxide - Class A or B fires only
 - 2-25 lb. 830 psi cylinders of liquefied CO₂
 - soda-acid extinguishers (sodium bicarbonate)
 - spray: $2\text{NaHCO}_3 + \text{H}_2\text{SO}_4 \rightarrow \text{Na}_2\text{SO}_4 + 2\text{H}_2\text{O} + 2\text{CO}_2$
 - foam: $6\text{NaHCO}_3 + \text{Al}_2(\text{SO}_4)_3 \rightarrow 3\text{Na}_2\text{SO}_4 + 2\text{Al}(\text{OH})_3 + 6\text{CO}_2$
- Carbon Tetrachloride - Class A-B-C
 - no longer used; can produce phosgene gas; CCl₄ is carcinogenic
 - $\text{CCl}_4 + \text{H}_2\text{O} \rightarrow \text{COCl}_2 + 2\text{HCl}$
- Halogenated Hydrocarbons - Class A-B-C
- Dry Chemical Extinguishers - Class A-B-C

Halogen Fire Extinguishants

- Halogenated Hydrocarbons (Halogens)
 - Halon numbering system:
 - 1st digit: no. of carbon atoms
 - 2nd digit: no. of fluorine atoms
 - 3rd digit: no. of chlorine atoms
 - 4th digit: no. of bromine atoms
 - 5th digit: no. of iodine atoms
 - Examples:
 - Halon 104 = CCl_4 , carbon tetrachloride
 - Halon 1011 = CH_2ClBr , bromochloromethane
 - Halon 1301 = CF_3Br , bromotrifluoromethane
 - Halon 1211 = CF_2ClBr , bromochlorodifluoromethane

Halogen Fire Extinguishants

- Halons 1301 and 1211 are most commonly used
 - gases at room temperature
 - heavier than air
 - produce Br atoms which scavenge free radicals
 - toxicity is controversial, but short term exposure appears safe
- Halons are “clean” extinguishants
 - do not leave any solid or liquid by-products
 - only alternative for vaults, museums, libraries, aircraft, and sensitive electronics
- Halons are greenhouse gases- displace atmospheric ozone
 - many halons are no longer manufactured; existing supply is all there is...

Dry Chemical Fire Extinguishants

- Granular sodium chloride: NaCl , melts at 801 C
- Graphite: C, usually used for class D fires
- Sodium bicarbonate: NaHCO_3
- Potassium bicarbonate: KHCO_3 , “purple K”
- ABC: ammonium dihydrogen phosphate, $\text{NH}_4\text{H}_2\text{PO}_4$
 - $2\text{NH}_4\text{H}_2\text{PO}_4 \rightarrow \text{P}_2\text{O}_5 + 2\text{NH}_3 + \text{H}_2\text{O}$
 - endothermic reaction absorbs heat
 - NH_3 scavenges OH radicals
 - most commonly used in household fire extinguishers
 - H_3PO_4 is produced which is corrosive to metals

Principles of Fire Extinguishants

- Fuel must pyrolyze into free radicals before combustion will occur:
 - H_2 and O_2 do not react until a spark is introduced to ignite them
 - HCl as a gas will not combust until exposed to sunlight
 - CH_4 will not combust until ignited
- Halon extinguishants are broken into free radicals with combine with and eliminate the free radicals of the fuel.
- CO_2 fire extinguishants are most effective in laboratory situations when used properly
- Fire sprinklers are not intended to extinguish fires!!!
 - Their purpose is lay down a fog and suppress the smoke so that people can escape from a burning room